

test report

Report No: 147419/4

Test of:

Timber garage door
Hope
with windows (glass)
16'0 x 8'0

Tested to:

BS EN 13241-1:2003

For:

Cedar Doors Ltd
Wimsey Way
Alfreton Trading Estate
Somercotes
Derbyshire
DE55 4LS
United Kingdom

TESTS OF INDUSTRIAL, COMMERCIAL and GARAGE DOORS and GATES

TESTED TO EN13241-1:2003

TEST CONCLUSIONS

Samples of:

Product : Timber garage door

Manufactured by Cedar door Ltd

Model : Hope with windows

Size : 16'0 x 8'0

have been tested in accordance with:

EN 13241-1:2003 Clause 4.4.3

By Warrington APT Laboratories Ltd.

At Key Industrial Park, Fernside Rd., Willenhall, West Midlands. WV13 3YA,

Results as detailed below:

Standard & Clause No.	Description	Compliance
EN 13241-1:2003 clause 4.4.1	Watertightness	N/t
EN 13241-1:2003 clause 4.2.9	Release of dangerous substances	N/t
EN 13241-1:2003 clause 4.4.3 EN 12424:2000 clause 4. EN 12444:2001 clause 7.1.2	Resistance to wind load – Class 0	No
EN 13241-1:2003 clause 4.4.5	Thermal resistance	N/t
EN 13241-1:2003 clause 4.4.6	Air permeability	N/t
EN 13241-1:2003 clause 4.2.2 EN 12604:2000 clause 4.4.1 EN 12605:2000 clause 5.1.5 EN 12453:2000 clause 5.3.5	Manual operation	N/t
EN 13241-1:2003 clause 4.2.8 EN 12604:2000 clause 4.3.4 EN 12604:2000 clause 5.3.2	Safe opening of vertical moving doors. Anti drop devices Out of balance forces	N/t
EN 13241-1:2003 clause 4.4.3 EN 12453:2000 clause 5.1 EN 12445:2000 clause 5.2	Operating forces	N/t
EN 13241-1:2003 clause 4.4.7	Durability of performance characteristics	N/t

No inferences can be made regarding performance against other requirements of this standard

TESTS OF INDUSTRIAL, COMMERCIAL and GARAGE DOORS and GATES
TESTED TO EN13241-1:2003

AUTHORISATION

Tests performed by: Steve Wilkes, Test Engineer

Report issued by: Steve Wilkes, Test Engineer

Signed *S. Wilkes*

Date : 07 December 2005

For and on behalf of Warrington APT laboratories Ltd

Report authorised by: Paul Duggan, Quality Manager

Signed *Paul Duggan*

Date *7 Dec 05*

For and on behalf of Warrington APT laboratories Ltd

Report issued: 07 December 2005



0621

NOTE.

Tests marked "Not UKAS Accredited" are not covered by the Laboratory UKAS accreditation schedule.

Tests marked NT were not tested

Tests marked NA are not applicable to the product on test.

Warrington APT Laboratories Ltd. is an EC Notified Body Number 1104

CONTENTS

TEST CONCLUSIONS	2
AUTHORISATION	3
TEST DETAILS	5
TEST RESULTS	6
Wind loading	6

TEST DETAILS

CLIENT DETAILS

Company name
Address

Cedar door Ltd
Wimsey Way
Alfreton Trading Estate
Somercotes
Derbyshire
DE55 4LS
United Kingdom
Tony Humphreys

Contact

ORDER DETAILS

Order number
Dated

Verbal

SAMPLE DETAILS

Product
Model
Markings
Manufacturer
Date of Manufacture
Other information

Timber garage door
Hope with windows (glass)
Not shown
Cedar door Ltd
01/06/05
Timber / Steel.

TEST DETAILS

Test reference nos.
Date sample received
Date test started
Date test completed
Specification tests conducted
to
Class and or Category
Special Test requirements
Other reports to be used in
conjunction with this report

147419/4
06/06/05
07/06/05
07/06/05
BS EN 13241-1:2003
To be determined
None
147419/1 – 147419/6

STANDARD REQUIREMENTS

Class 1 300 Pascals
Class 2 450 Pascals
Class 3 700 Pascals
Class 4 1000 Pascals
Class 5 above 1000 Pascals as agreed with client

Note All classes must withstand 25% overload


TEST RESULTS

WIND LOADING – Clause 4.4.3 of BSEN 13241-1:2003-10-30


TEST METHOD – door loaded by inflated air bag

The standard requires a load to be applied to both faces of the door in turn.

The apparatus consists of a fixed frame into which the door under test is fitted and a mobile frame onto which is fixed the air bag used to apply the pressure to the door.

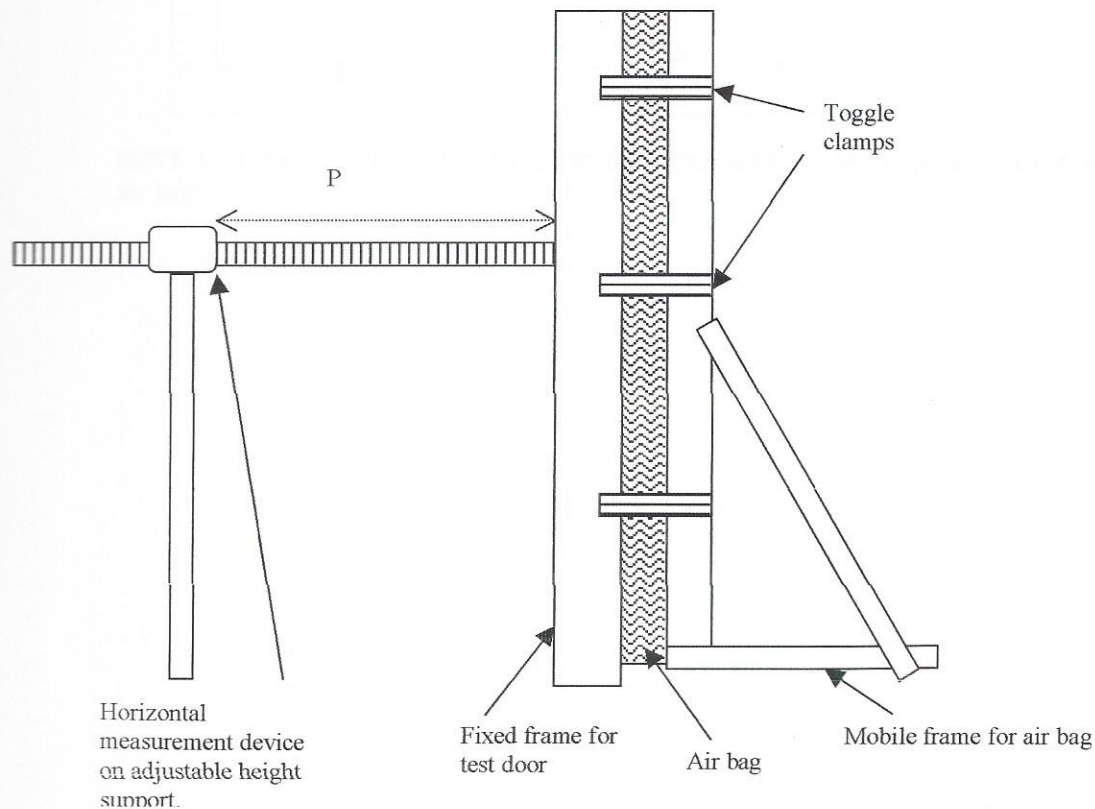

TESTS OF INDUSTRIAL, COMMERCIAL and GARAGE DOORS and GATES
TESTED TO EN13241-1:2003

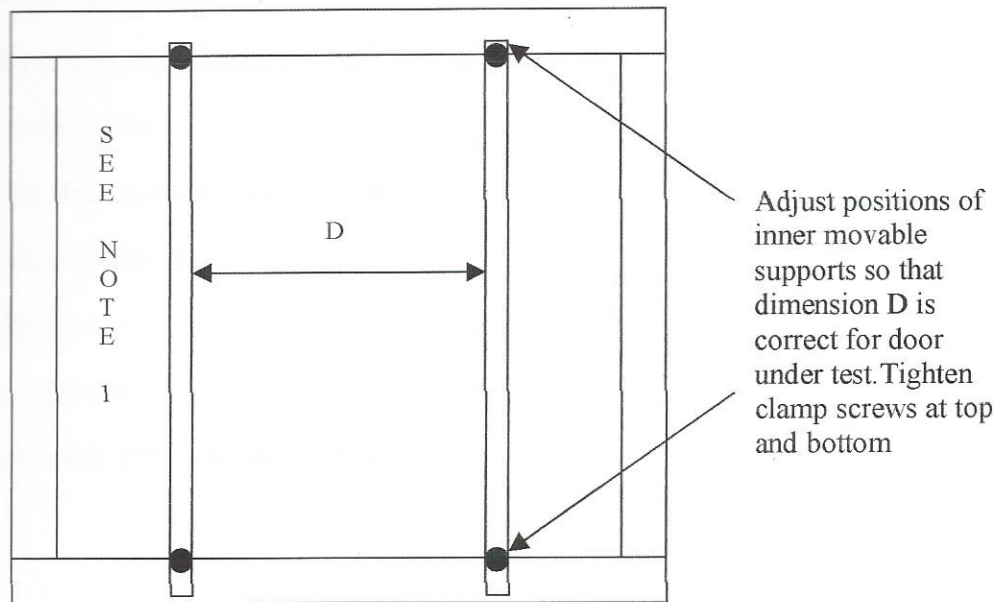

NOTE 1 If door under test is narrower than the outer frame fill gaps at either side to restrain air bag.

Details of door tested:

Model : Hope with windows (glass) Timber garage door

Size : 16'0 x 8'0

Construction and materials : Timber

Details of frame tested:

Model : Timber

Size : 16'0 x 8'0

Construction and materials : Timber.

Date of manufacture : 01/06/05

Date of test : 07/06/05

Storage conditions between manufacture and test : Not specified.

Details of frame fixing to test rig: Bolted

Full details of door and frame in annex A

Required Class =	Reference wind load (Pa)
	Overload wind load (Pa)

Test 1 – load on outer face

Ambient temperature 21.6°C

Pressure Pa	Position of centre mm	Deflection mm	Movement out of guide	
			LH(mm) I	RH(mm)
Zero	2050	-----	-----	-----
361	-----	-----	-----	-----

Permanent distortion : YES

Breakage of components : YES
(details)

Permanent deformation which could influence safety : YES
(details)

Deflection of materials to allow disengagement of door and frame : YES
(details)

361 Pa achieved (0 Class) on the outer face loaded in the inwards direction before end damaged, wood broke away.

Test 2 – load on inner face

Ambient temperature °C

Pressure Pa	Position of centre mm	Deflection mm	Movement out of guide	
			LH(mm)	I RH (mm)

Permanent deformation which could influence safety : no
(details)

Deflection of materials to allow disengagement of door and frame : no
(details)

Wind load class achieved

Inwards : No class achieved.

Outwards : Not tested.

Observations and comments.

Inner face not tested due to no class achieved on outer face.

----- END OF REPORT -----